



REVISION	BY	DATE



1045 Eaton Drive  
 FT. Wright, Kentucky 41017  
 Ph: (859) 578-7460  
 Fax: (859) 331-2436

DATE: MAY 2010  
 STANDARD DRAWING NO. STM-12.0

SANITATION DISTRICT NO. 1

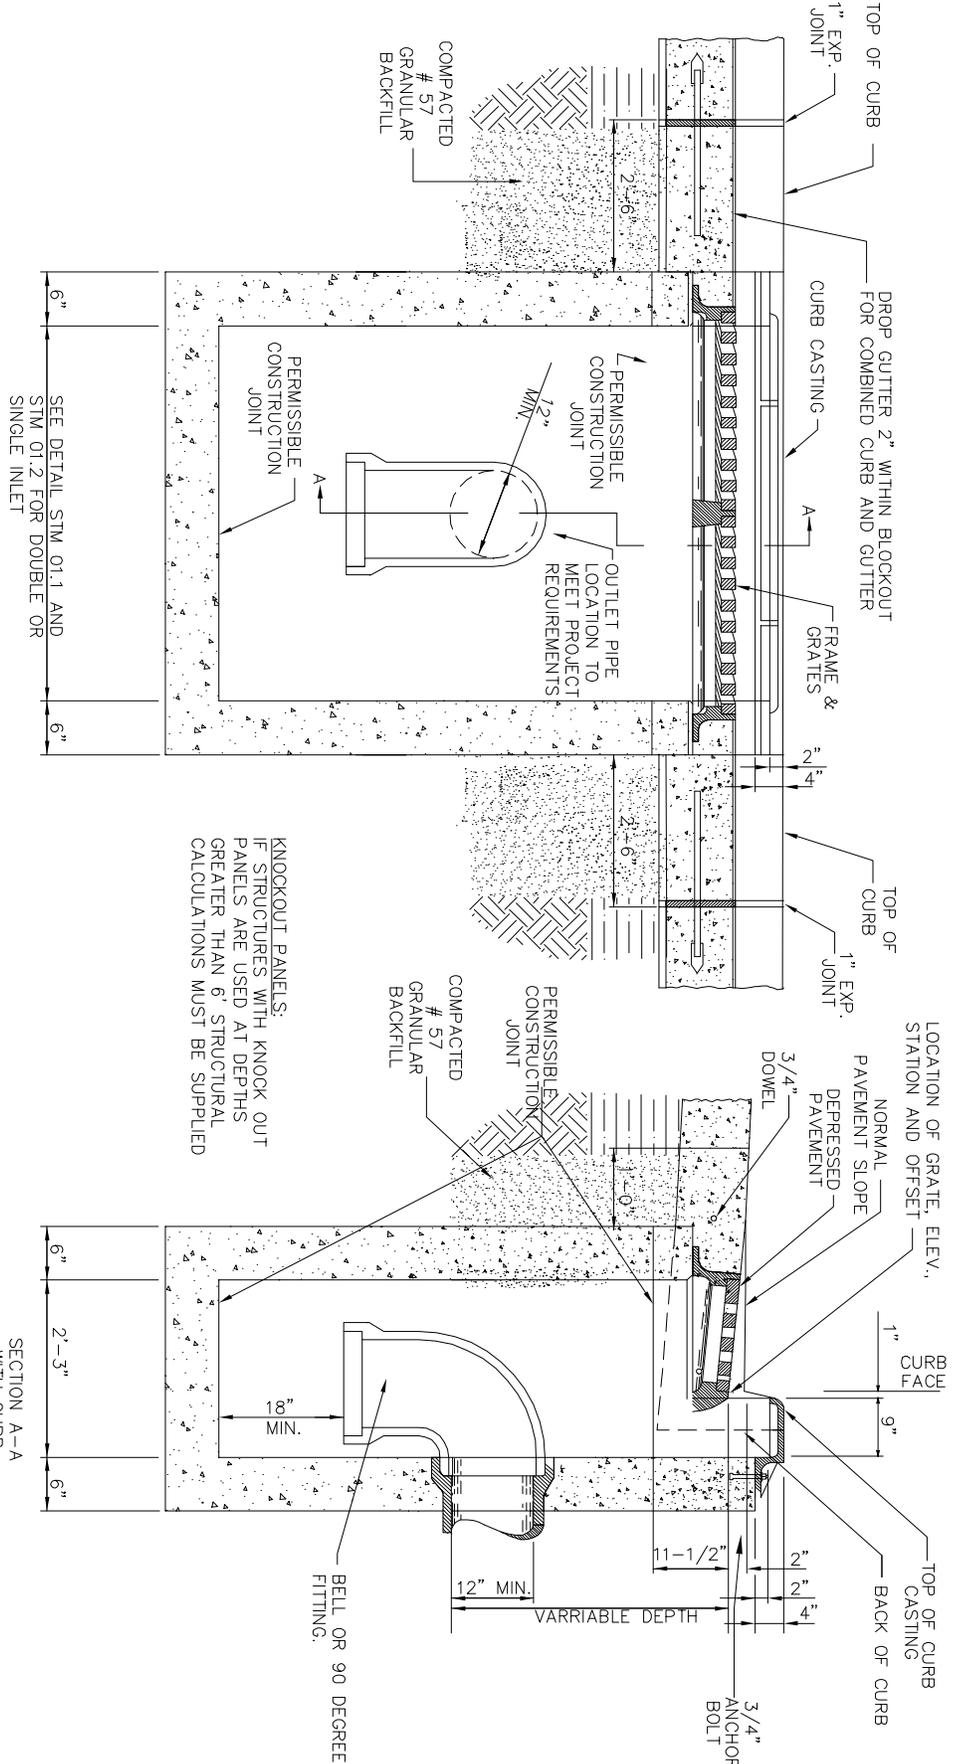

- NOTES:
1. CURB INLETS WITH BELL ARE TO BE USED IN THE COMBINED SEWER SYSTEM OR AS DIRECTED BY SD1.
  2. CURB INLETS WITH BELL SHALL BE USED WITH EITHER SINGLE OR DOUBLE CURB INLET. SEE DETAILS STM 01.1 AND 01.2 FOR INFORMATION ON GRATING, BLOCKOUTS, AND BACKFILL NOTES.
  3. BOTTOM OF BELL SHALL MAINTAIN AT LEAST 18" OF VERTICAL SEPERATION FROM THE BOTTOM OF THE BASIN. ALSO, THE INVERT OF THE LOWEST INCOMING PIPE SHALL BE HIGHER THAN THE BOTTOM OF THE BELL.
  4. ANTI-SIPHON DEVICES ARE ACCEPTABLE BASED ON SD1 PRE-APPROVAL

KNOCKOUT PANELS:  
 IF STRUCTURES WITH KNOCK OUT PANELS ARE USED AT DEPTHS GREATER THAN 6' STRUCTURAL CALCULATIONS MUST BE SUPPLIED

REFER TO DWG STM 01.2 AND STM 02.1 FOR NOTES

TRAPPED CATCH BASIN (STM-12.0)

N.T.S.