


NOTES

1. PERMIT FEE AND INSPECTION REQUIRED
2. DROP CONNECTION TO BE MADE BELOW CONE SECTION.
3. DROP CONNECTION SHALL NOT INTERFERE WITH MANHOLE STEPS.
4. DROP CONNECTION MUST NOT DISTURB INTEGRITY OF JOINTS
5. LATERAL TAP IN MANHOLE WALL SHALL BE CORE-DRILLED AND A PRESSURE FITTED BOOT WITH STAINLESS STEEL BANDS USED TO MAKE A WATER TIGHT SEAL\
6. ALL NOTES ON STANDARD DRAWING 113 SHALL APPLY

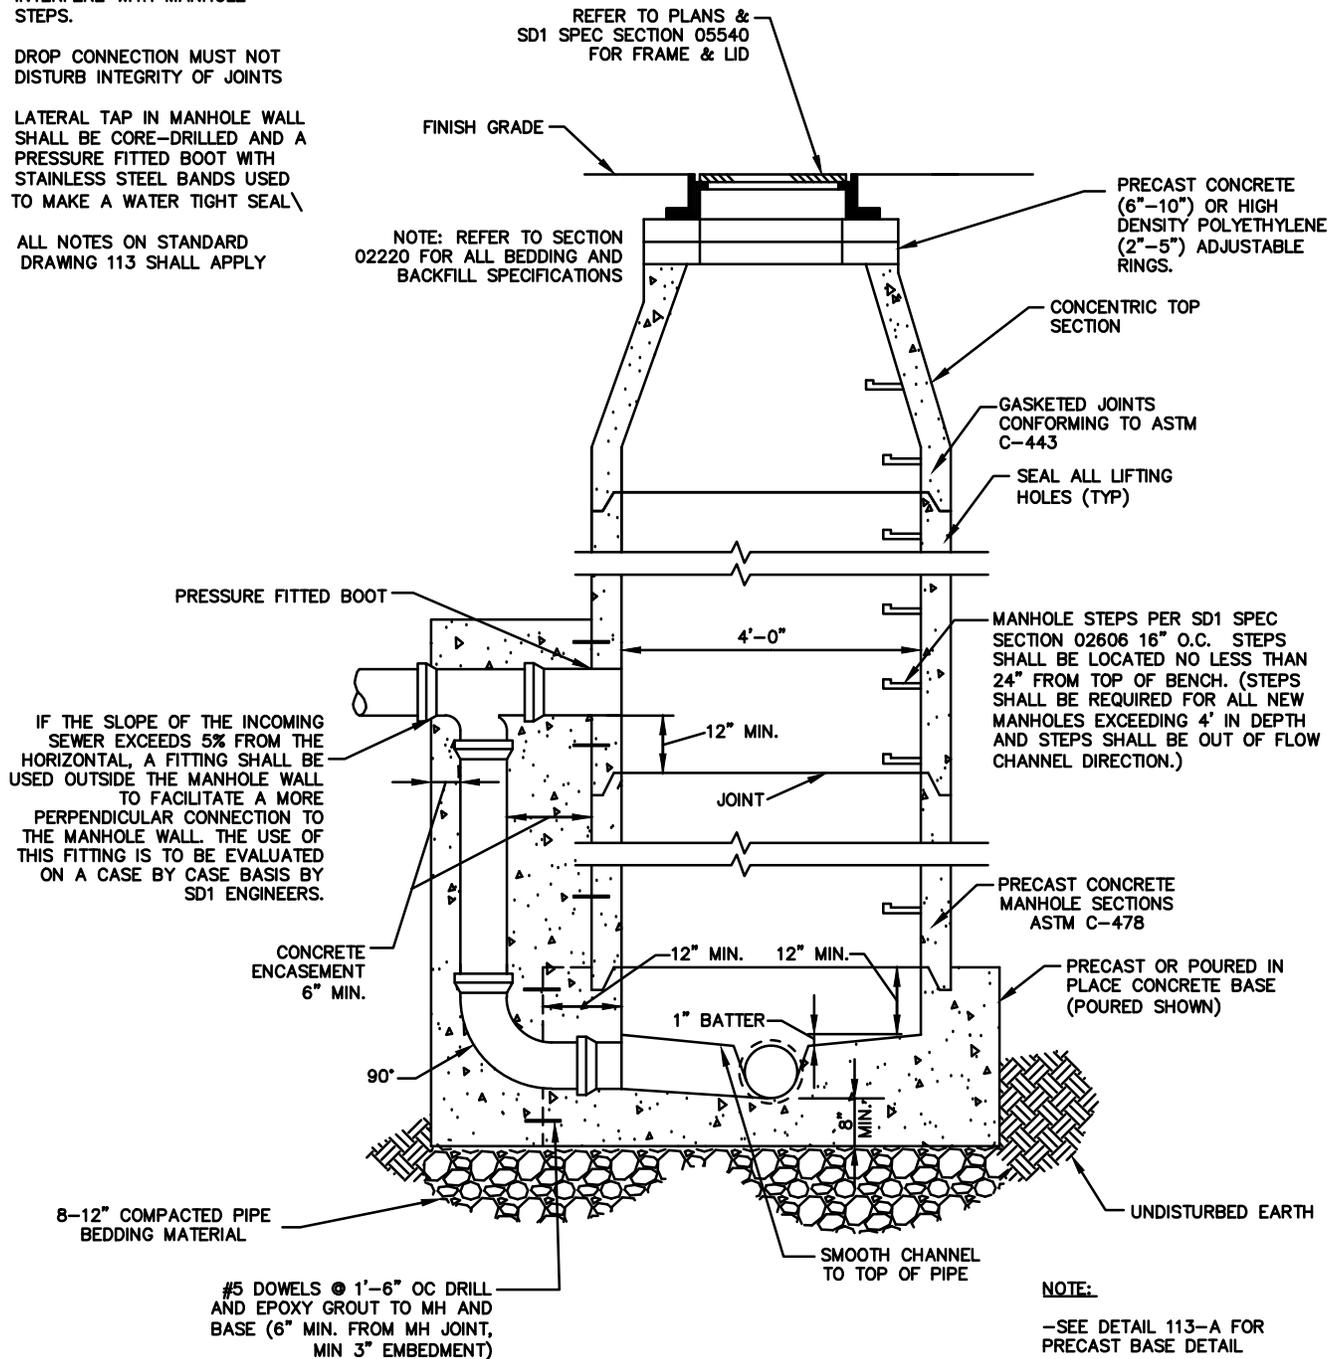

DROP MANHOLE
N.T.S.

NOTE:
-SEE DETAIL 113-A FOR PRECAST BASE DETAIL

-ANTI-FLOTATION FLANGES MAY BE REQUIRED IN AREAS WHERE THE MANHOLE IS SUBJECT TO GROUND WATER PER SD1 SPECIFICATION 02606

REVISION	BY	DATE



SANITATION DISTRICT NO. 1
1045 Eaton Drive
FT. Wright, Kentucky 41017
Ph: (859) 578-7460
Fax: (859) 331-2436

DATE:
AUGUST 2018

STANDARD DRAWING NO:
114